


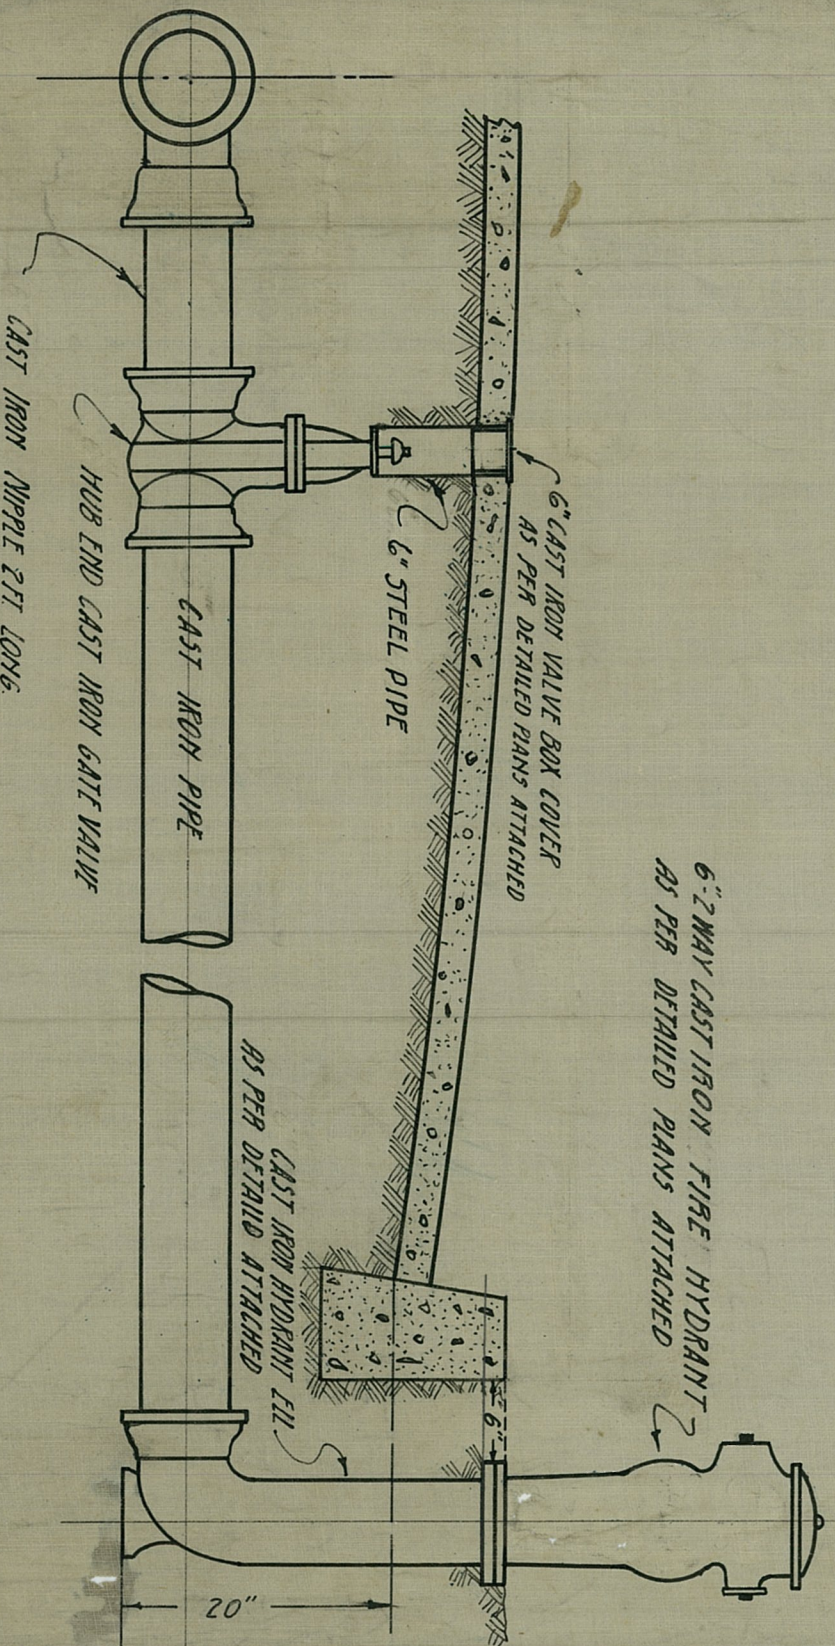

- Fire Hydrant Connection with 4" Main
- 1-4" Cast Iron Gate Valve.
 - 1-6" Steel Valve Box and C.I. Cover
 - 1-4" C.I. Nipple - 2' Long.
 - 1-4" C.I. Pipe from Gate Valve to Hydrant Ell.
 - 1-4" X 6" C.I. Hydrant Ell.
 - 1-6" - 2 Way Fire Hydrant
 - 1-4" X 4" C.I. Tee

- Fire Hydrant Connection to 6" Main or Larger:
- 1-6" X Size of Main C.I. Tee.
 - 1-6" C.I. Nipple - 2' Long.
 - 1-6" C.I. Gate Valve
 - 1-6" Steel Valve Box and C.I. Cover
 - 1-6" C.I. Pipe from Gate Valve to Hydrant Ell.
 - 1-6" X 6" C.I. Hydrant Ell.
 - 1-6" - 2 Way Fire Hydrant.

NOTE

Hydrant Ell to be 4" x 6" or 6" x 6"

*This drawing has been
superceded by drawing
Det. 3000-B. Dated 11/28/45*

DRAWN BY *AMS*
CHECKED BY *MS. Phelps*
FIELD BOOKS
George Gammack
CITY ENGINEER
J.M. Kocourek
MGR. OF OPERATION

CITY OF SAN DIEGO ENGINEERING DEPARTMENT
DETAIL OF FIRE HYDRANT CONNECTION
CITY OF SAN DIEGO

DATE *AUG. 15 1917*
SCALE *NONE*
DRAWING NUMBER
325-B