



Bacteria in 1 cubic centimeter of Water.

500

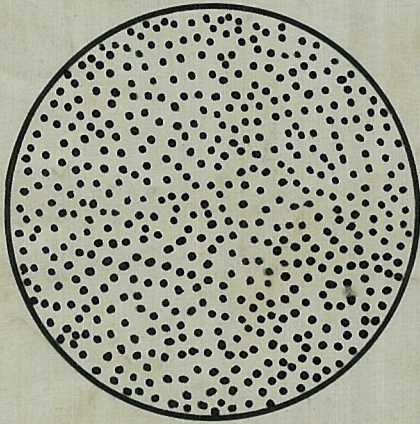


Objectionable

100

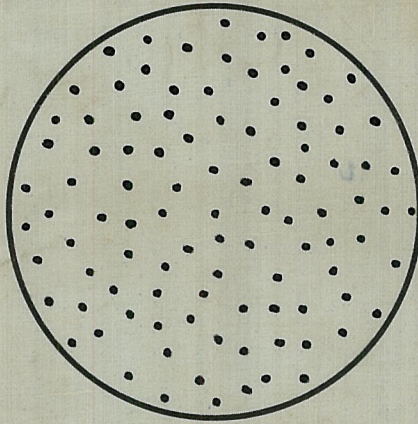


*Maximum allowed
by U.S. Health
Service*

5

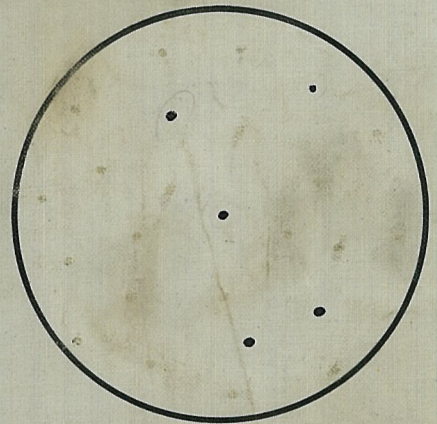

San Diego's water


SAN DIEGO WATER, SAFEST THERE IS.

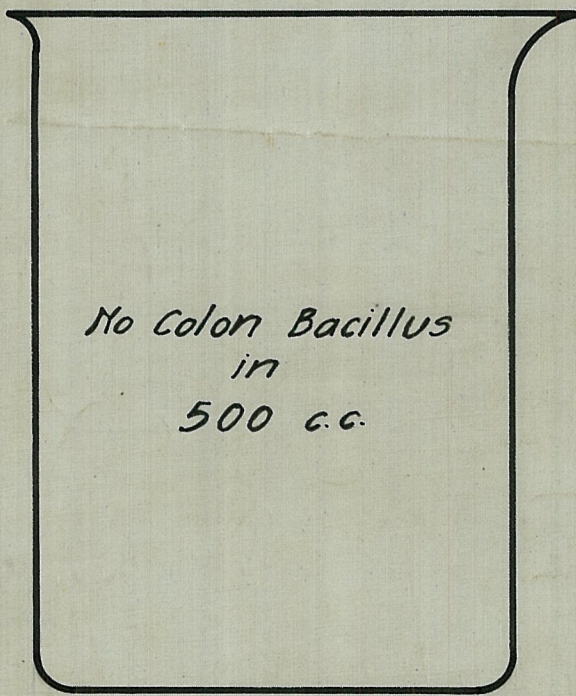

*No Colon Bacillus
in
500 c.c.*

San Diego

*1 Colon Bacillus
in $\frac{1}{10}$ c.c.*



Dangerous

MICROFILMED

FEB 1 1963

DRAWN BY F.H.T.

CHECKED BY

FIELD BOOKS

George Cronwell
CITY ENGINEER
John L. Bacon
ASST MGR. OF OPERATION

CITY OF SAN DIEGO--OPERATING DEPARTMENT

**DIAGRAM OF BACTERIA IN
SAN DIEGO WATER**

DATE 12-9-15

SCALE

DRAWING NUMBER

65-B