


Note: Reinforcement shown applies to middle three piers only. Bottoms of piers must be on firm ground and in no case shall bottom of pier be less than 1'-0" below bottom of pipe.

DETAILS OF CONCRETE PIERS
Scale: 1/2" = 1'

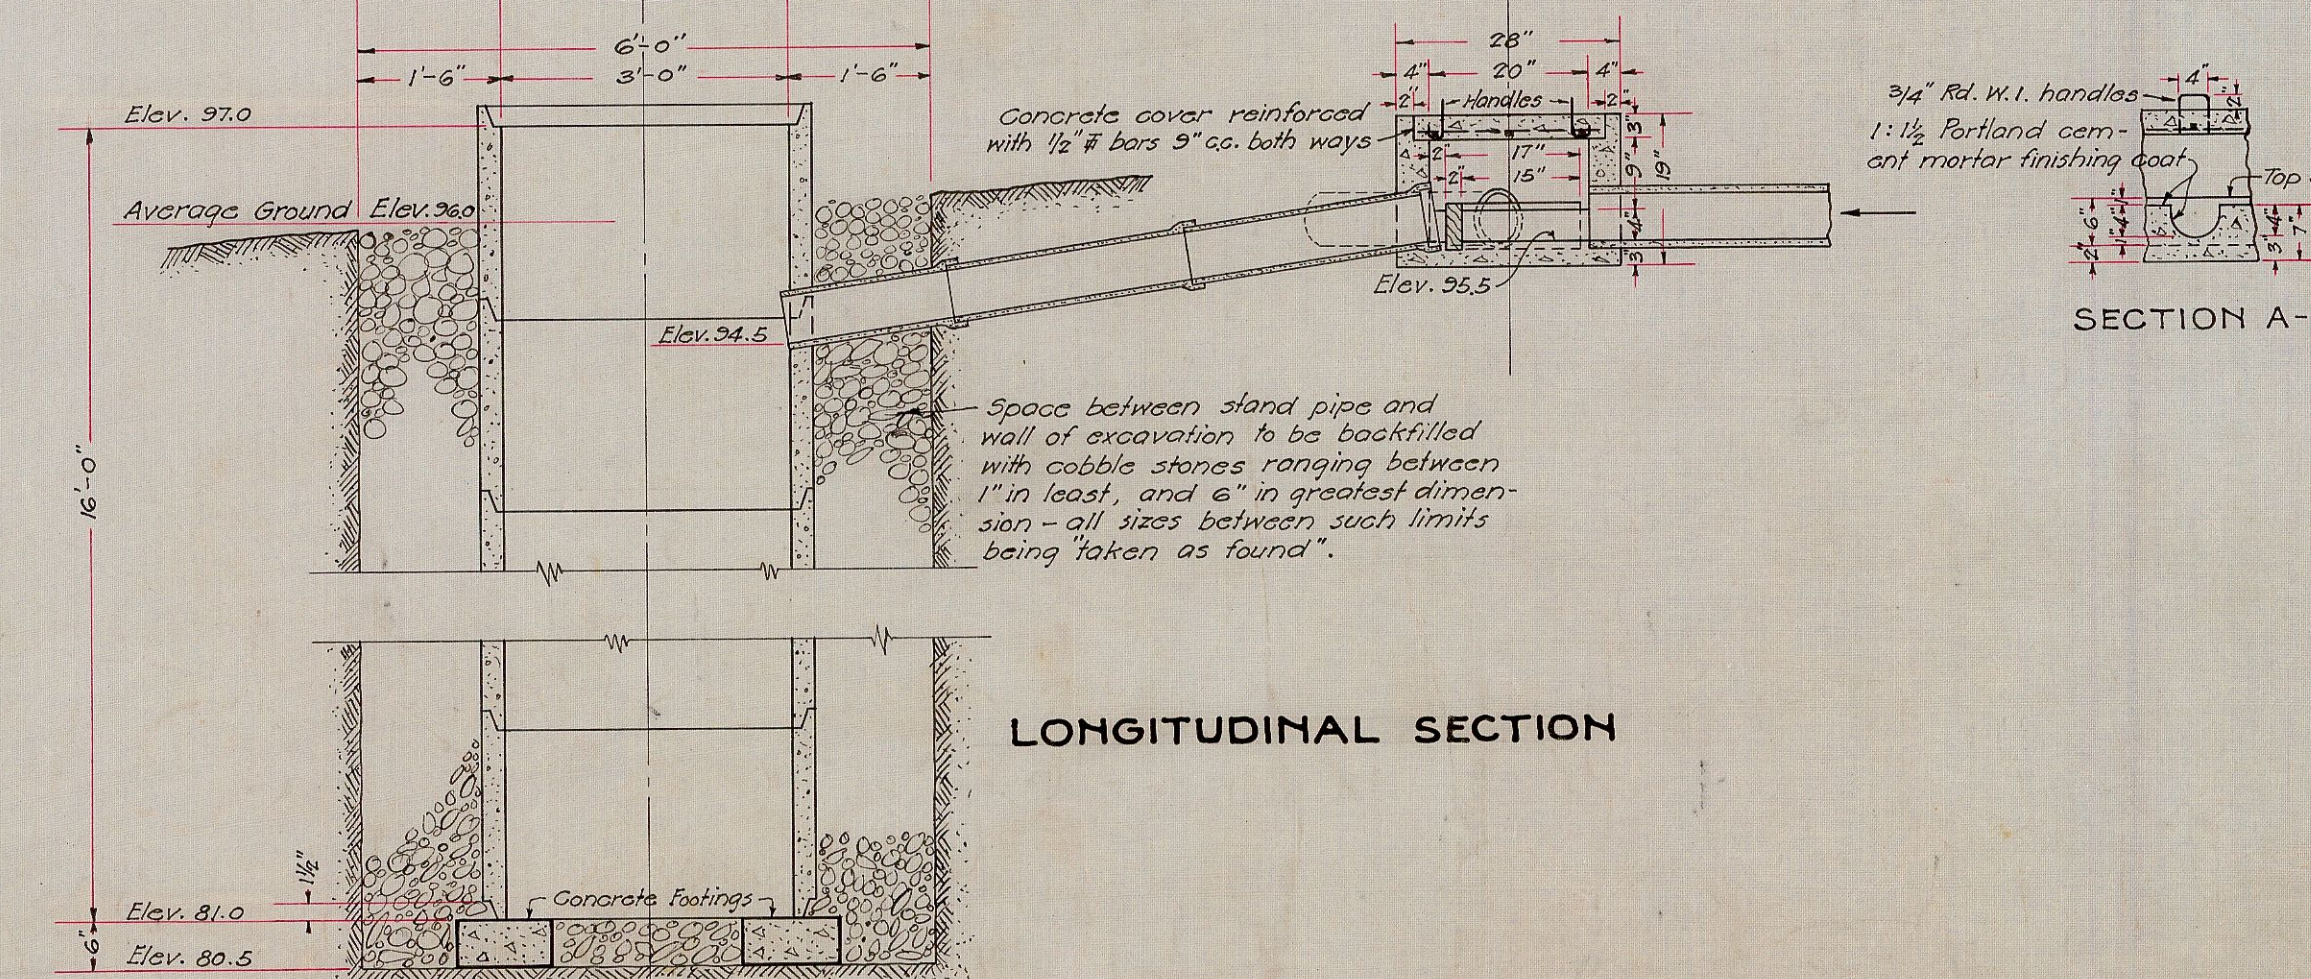

MICROFILMED
APR -- 1963

E.F.-18

PLANS FOR
SEWAGE DISPOSAL
FOR
ALLEN TERRACE
EFFLUENT LINE

SCALE AS SHOWN

December 1920.
Book 533.

455-D